


INFORME CENTRAL HIDROEÓLICA 2018 - GORONA DEL VIENTO, EL HIERRO



GRUPO	POTENCIA NOMINAL (MW)	ENERGÍA PRODUCIDA (MWh)	% GENERADO	HORAS DE OPERACIÓN	VIENTO Ø (m/s)	VIENTO MÁX (m/s)	
AEROGENERADOR 1	2.3	6.450,85	18,56%	7.605,28	7,90	32,50	
AEROGENERADOR 2	2.3	6.268,23	18,03%	7.468,38	8,40	34,00	
AEROGENERADOR 3	2.3	7.165,56	20,61%	7.617,08	8,90	37,80	
AEROGENERADOR 4	2.3	7.551,22	21,72%	7.699,50	9,10	37,90	
AEROGENERADOR 5	2.3	7.324,43	21,07%	7.526,88	9,10	35,10	
TOTAL	11.5	34.760,28	% GENERADO	HORAS EQUIVALENTES	DISPONIBILIDAD (%)		
TURBINA 1	2.83	1.719,02	20,00%	607,43	98,74		
TURBINA 2	2.83	1.851,16	21,54%	654,12	97,09		
TURBINA 3	2.83	2.396,42	27,89%	846,79	98,75		
TURBINA 4	2.83	2.626,36	30,56%	928,04	97,19		
TOTAL	11.32	8.592,95	CONSUMO TOTAL (MwH)		EVACUACIÓN (MwH)		
LINEA LLANOS BLANCOS 1				138,688	10.632,17		
LINEA LLANOS BLANCOS 2				0,571	13.162,63		
TOTAL:				139,259	23.794,799		

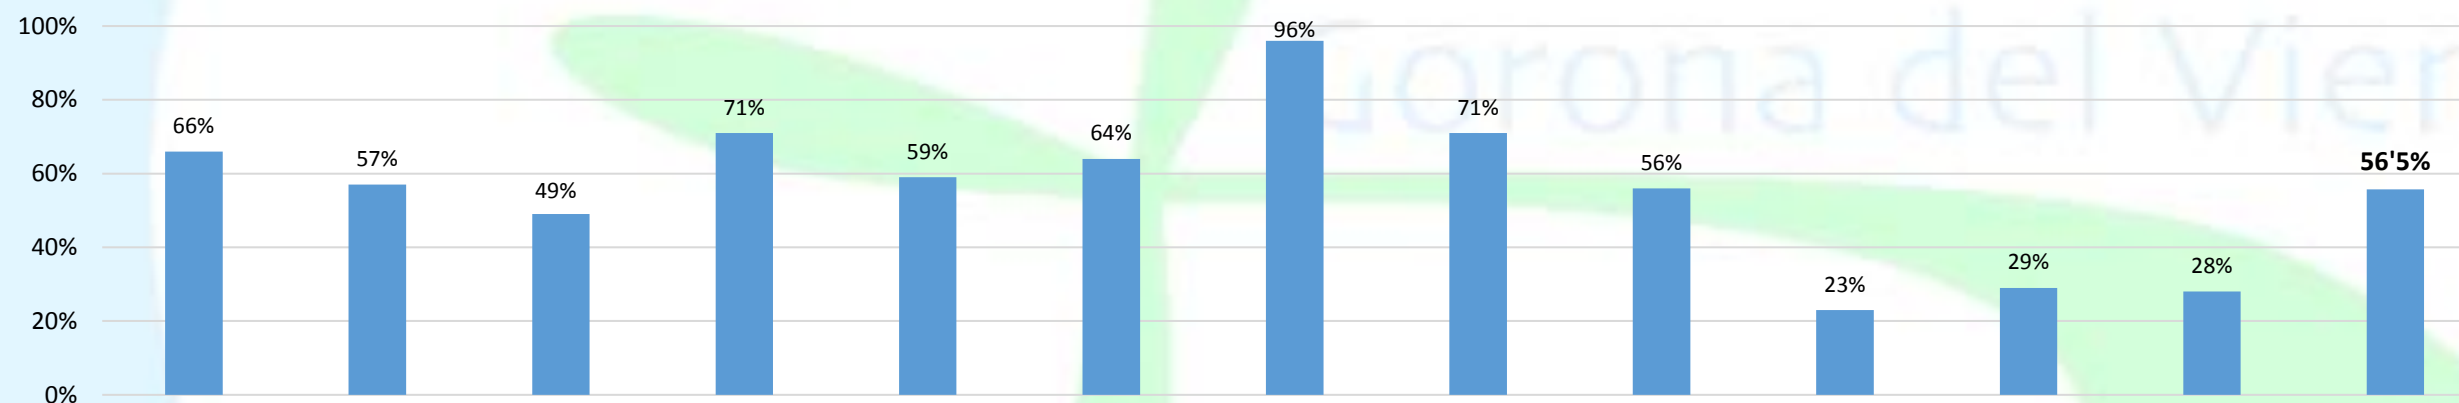

	ENERO	FEBRERO	MARZO	ABRIL	MAYO	JUNIO	JULIO	AGOSTO	SEPTIEMBRE	OCTUBRE	NOVIEMBRE	DICIEMBRE	TOTAL 2018
Evacuación	2.258,22	1.767,90	1.627,59	2.263,07	2.034,27	2.323,92	3.716,28	2.867,67	2.175,67	920,31	919,53	920,37	23.794,80
Consum red	0,45	13,60	28,07	0,43	0,07	2,12	0,00	8,35	9,81	47,01	18,74	10,63	139,26
Aeros	3.486,37	2.473,01	2.533,19	3.349,89	3.008,84	3.221,06	5.443,50	4.135,43	3.050,56	1.288,54	1.378,77	1.391,03	34.760,19
Turbina	994,56	668,05	631,15	906,58	688,86	797,92	1.347,22	929,98	745,72	277,33	289,86	315,71	8.592,94
SSAA	54,82	46,27	50,60	49,37	44,32	51,97	65,94	61,59	55,99	46,68	42,26	43,10	612,90
Bombeo	2.156,08	1.329,66	1.500,14	1.932,33	1.608,52	1.596,70	2.947,52	2.093,90	1.529,99	616,75	692,26	730,69	18.734,54
Generación GdV%	66%	57%	49%	71%	59%	64%	96%	71%	56%	23%	29%	28%	56.5%
Horas al 100%	282	272	224	159	112	173	650	339	89	0	0	0	2.300

